
THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS. THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDING OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION. CHANGES OR MODIFICATIONS TO PRINT OR DESCRIPTION OF NOTION BEFOREMED WITHOUT EXPRESSED WRITTEN PROMISSION BY AVAIEN, INC.

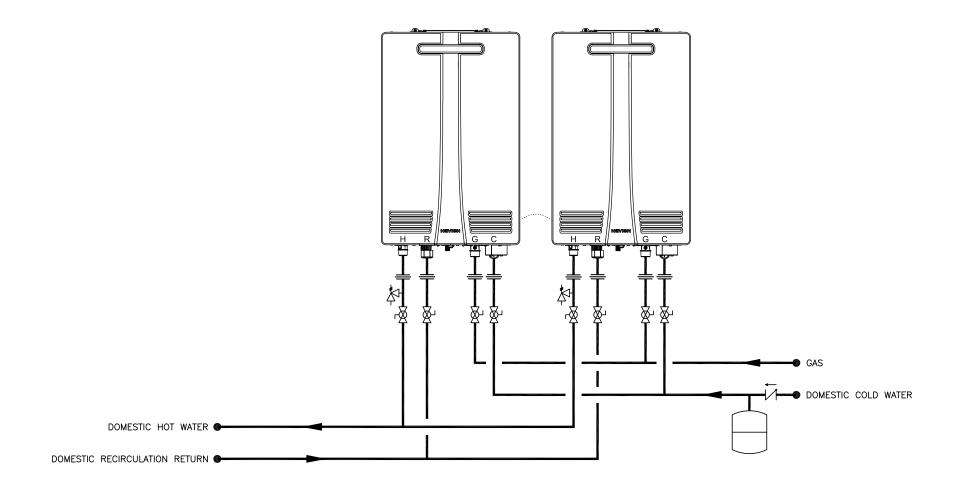

TANKLESS QUANTITY: RECOMMENDED PIPE SIZE	1 UNIT: 3/4" 2 UNITS: 1" 3 UNITS: 1-1/4" 4-5 UNITS: 1-1/2" 6-8 UNITS: 2" 9-14 UNITS: 2-1/2" 15-16 UNITS: 3			5-16 UNITS: 3"	" SYMBOL LEGEND			
Maylen	NHW-AE SERIES TANKLESS WATER HEATER - OUTDOOR UNIT			— UNION	CHECK VALVE	FULL-PORT VALVE	T AQUASTAT	
MINGVICIN	(2) NHW-AE TANKLESS WATER HEATERS WITH EXTERNAL RECIRCULATION MODE			CASCADE CABLE	PRESSURE RELIEF VALVE	EXPANSION TANK	т	
20 GOODYEAR IRVINE CA 92618	IRVINE, CA 92618 800-519-8794 INCLUDES MODELS 160, 180 AND 199							
800-519-8794								
www.navieninc.com	DRAWN BY: S. STOEKE	NHW-AE-2-E	JULY 2	27, 2023				1