


This drawing is intended only as a guide and not as a replacement for professionally engineered project drawings. This concept system drawing does not imply compliance with local building codes. Actual installation may vary depending on installation location & parameters and it must be done in accordance to all local building codes. Verify with local building officials before commencement of system installation.

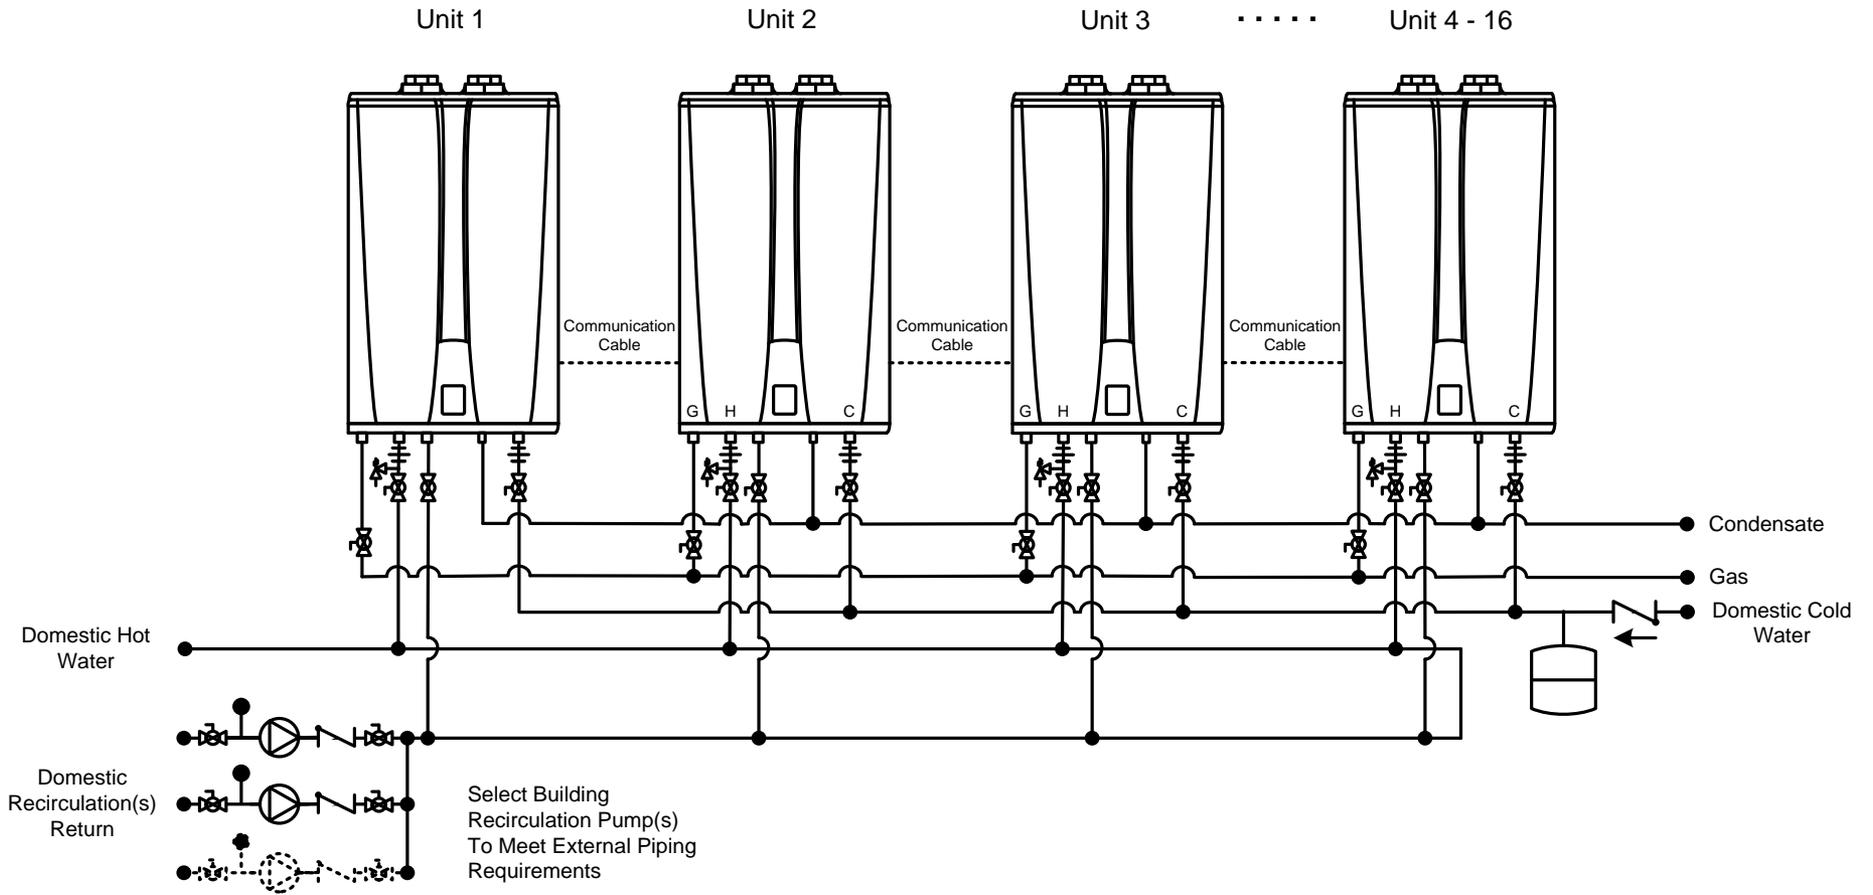

Recommended Pipe Size/Heater Count	1 Unit - 3/4"	2 Units - 1"	3 Units - 1-1/4"	4 to 5 Units - 1-1/2"	6 to 8 Units - 2"	9 to 14 Units - 2-1/2"	15 to 16 Units - 3"
<p>20 Goodyear Irvine, CA 92618 800-519-8794 www.navienamerica.com</p>	<b>NPE-A Series Tankless Water Heater</b>  <b>Four Plus NPE-A Tankless External Recirculation Mode With External Circulator(s)</b>				Storage Vessel Check Valve Pressure Relief Valve Mixing Valve Full-port Ball Valve DHW Circulator w/Aquastat & Check Valve Circulator Expansion Tank Aquastat		
	Drawn By: B. Fenske	NPE-A-4Plus-ECS-BF02	August 1, 2013				