
THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS. THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION. CHANGES OR MODIFICATIONS TO PRINT OR DESCRIPTION TO THE PERFORMED WITHOUT EXPRESSED WRITTEN PERMISSION BY NAMEN, INC.

## **DHW RECIRCULATION REQUIREMENTS:**

\* REFER TO NAVIEN I & O MANUAL FOR INSTALLATION REQUIREMENTS AND FURTHER INFORMATION.

EXPANSION TANK

UNION

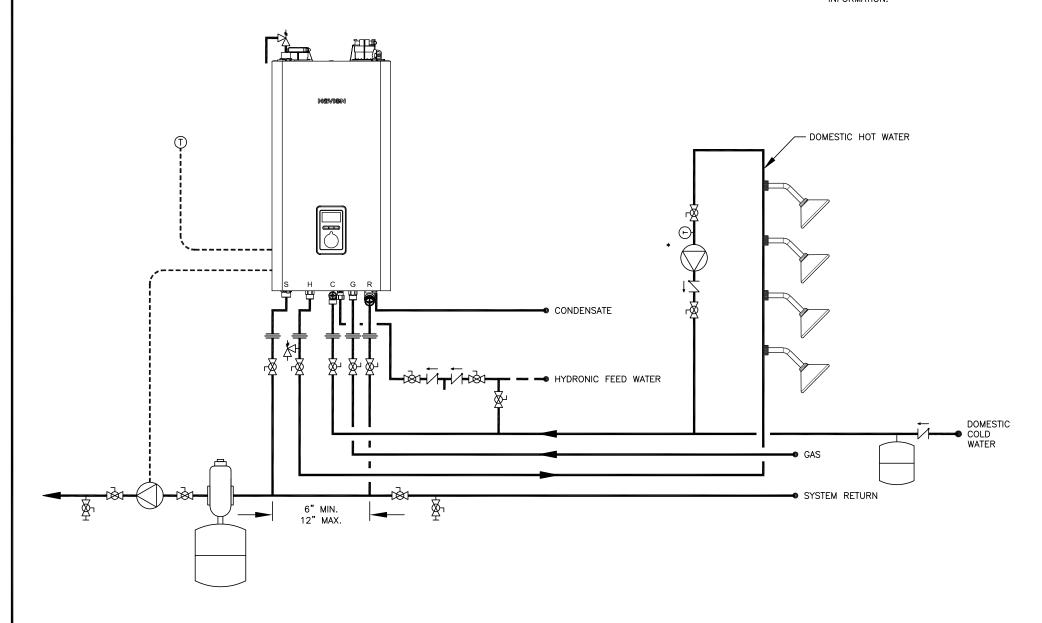

Mavien				
20 GOODYEAR				
IRVINE, CA 92618				
800-519-8794				
www.navieninc.com				

			SYMBOL LEGEND			
NFC-H SERIES COMBI-BOILER		BACKFLOW PREVENTER	CHECK VALVE	FULL-PORT VALVE		
(1) NFC-H COMBI-BOILER APPLICATION		1 PREVENIER				
DHW RECIRCULATION SHOWN		CONTROL WIRING	PRESSURE RELIEF VALVE	-CIRCULATOR		
INCLUDES MODELS NFC-250/175H, NFC-250/200H		①	☐ AIR			
DRAWN BY: S. STOEKE	IFC-H-1-ZP	MAY 25, 2022	Ψ AQUASTAT	ELIMINATION	BALL DRAIN VALVE	